

Fixed-mounted circuit breaker 3-pole, Size 2, IEC In=800 A up to 690 V, 50/60 Hz AC Icu=66 kA at 500 V Rear horizontal connection Overcurrent release ETU 27 LSING protection adjustable 0.4-1 in Ground fault/N protection integrated With manual operating mechanism with storage with mechanical request without 1st auxiliary release without 2nd auxiliary release 2NO+2NC F40= Sealing disc for ETU25-76 for protection against unauthorized operation K07= Tripped signaling contact, 1 CO not possible with option F02 S08= RONIS locking device in Off position (safe OFF/disconnector functionality) Disconnecter condition in compliance with IEC 60947-2 Disconnecter condition in compliance with IEC 60947-2 T40= Door sealing frame

Further information

Information on the packaging

<https://support.industry.siemens.com/cs/ww/en/view/109813875>

Industry Mall (Online ordering system)

<https://mall.industry.siemens.com/mall/en/en/Catalog/product?mlfb=3WL1208-2DG62-1AA2-Z F40+K07+S08+T40>

Service&Support (Manuals, Certificates, Characteristics, FAQs,...)

<https://support.industry.siemens.com/cs/ww/en/ps/3WL1208-2DG62-1AA2-Z F40+K07+S08+T40>

Image database (product images, 2D dimension drawings, 3D models, device circuit diagrams, ...)


http://www.automation.siemens.com/bilddb/cax_en.aspx?mlfb=3WL1208-2DG62-1AA2-Z F40+K07+S08+T40


CAX-Online-Generator

<http://www.siemens.com/cax>

Tender specifications

<http://www.siemens.com/specifications>

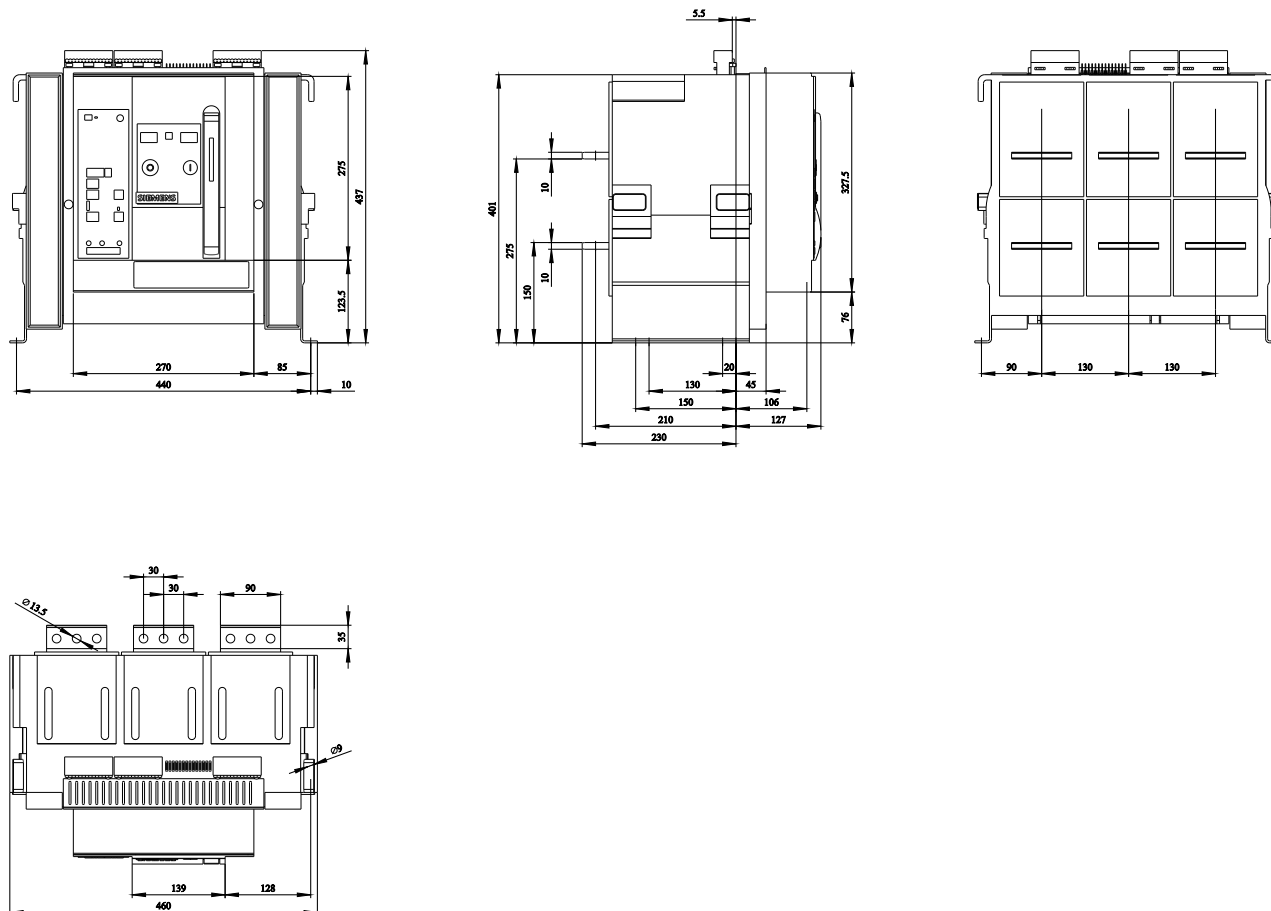

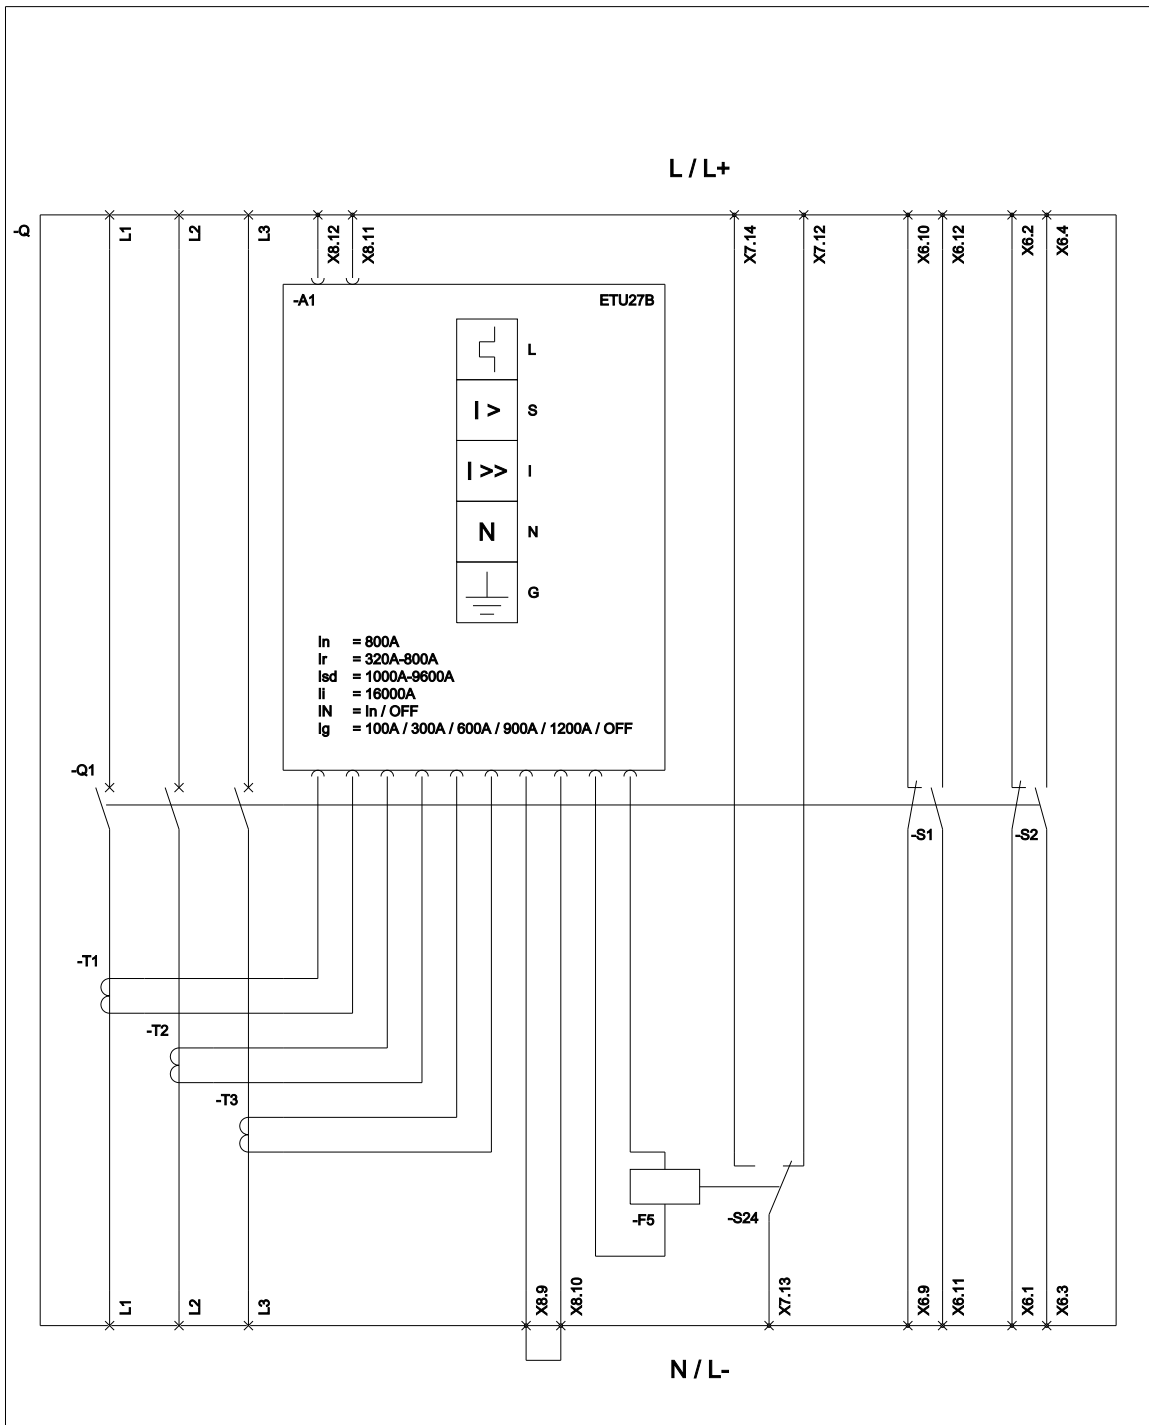

L (Long Time Delay / Überlastschutz); S (Short Time Delay / Kurzschlusschutz, kurzzeitverzögert); I (Instantaneous / Kurzschlusschutz, unverzögert);
 N (Neutral Protection / Neutralleiterschutz); G (Ground Fault Protection / Erdschlusschutz); F5 (Maglatch for trip unit / Auslösemagnet);
 S1 - S8 (Auxiliary switch / Hilfschalter); S24 (1st trip signalling switch K07 (Reset position) / Erster Ausgelöstmeldeshalter K07 (Reset Position));

last modified:

8/5/2024

